


**CONSTRUCTION**

- SPECFLUE TO PROVIDE ONLY EQUIPMENT WITHIN DEMARCATION APART FROM EXPANSION VESSEL, AUTO FILL UNIT AND NO CONTROLLING VALVES (MANUAL).
- EQUIPMENT TO BE FREE ISSUED TO MECHANICAL CONTRACTOR.
- SPECFLUE TO ASSIST IN COMMISSIONING AND INSPECT WORKS.
- BOILER CONNECTIONS ARE 42MMØ.
- CHP CONNECTIONS ARE 28MMØ.
- 76MM CONNECTIONS TO DHWS PLATE HEAT EXCHANGE MANIFOLD.
- 54MM CONNECTION TO UHF PLATE HEAT EXCHANGE MANIFOLD.
- 35MM CONNECTIONS TO BOLCK D RAD AND COMMERCIAL UNIT PLATE HEAT EXCHANGE MANIFOLD.
- PIPEWORK INTERLINKING THERMAL STORES TO BE 100MM AND MANUAL VALVES SHOULD BE FULL-BORE.

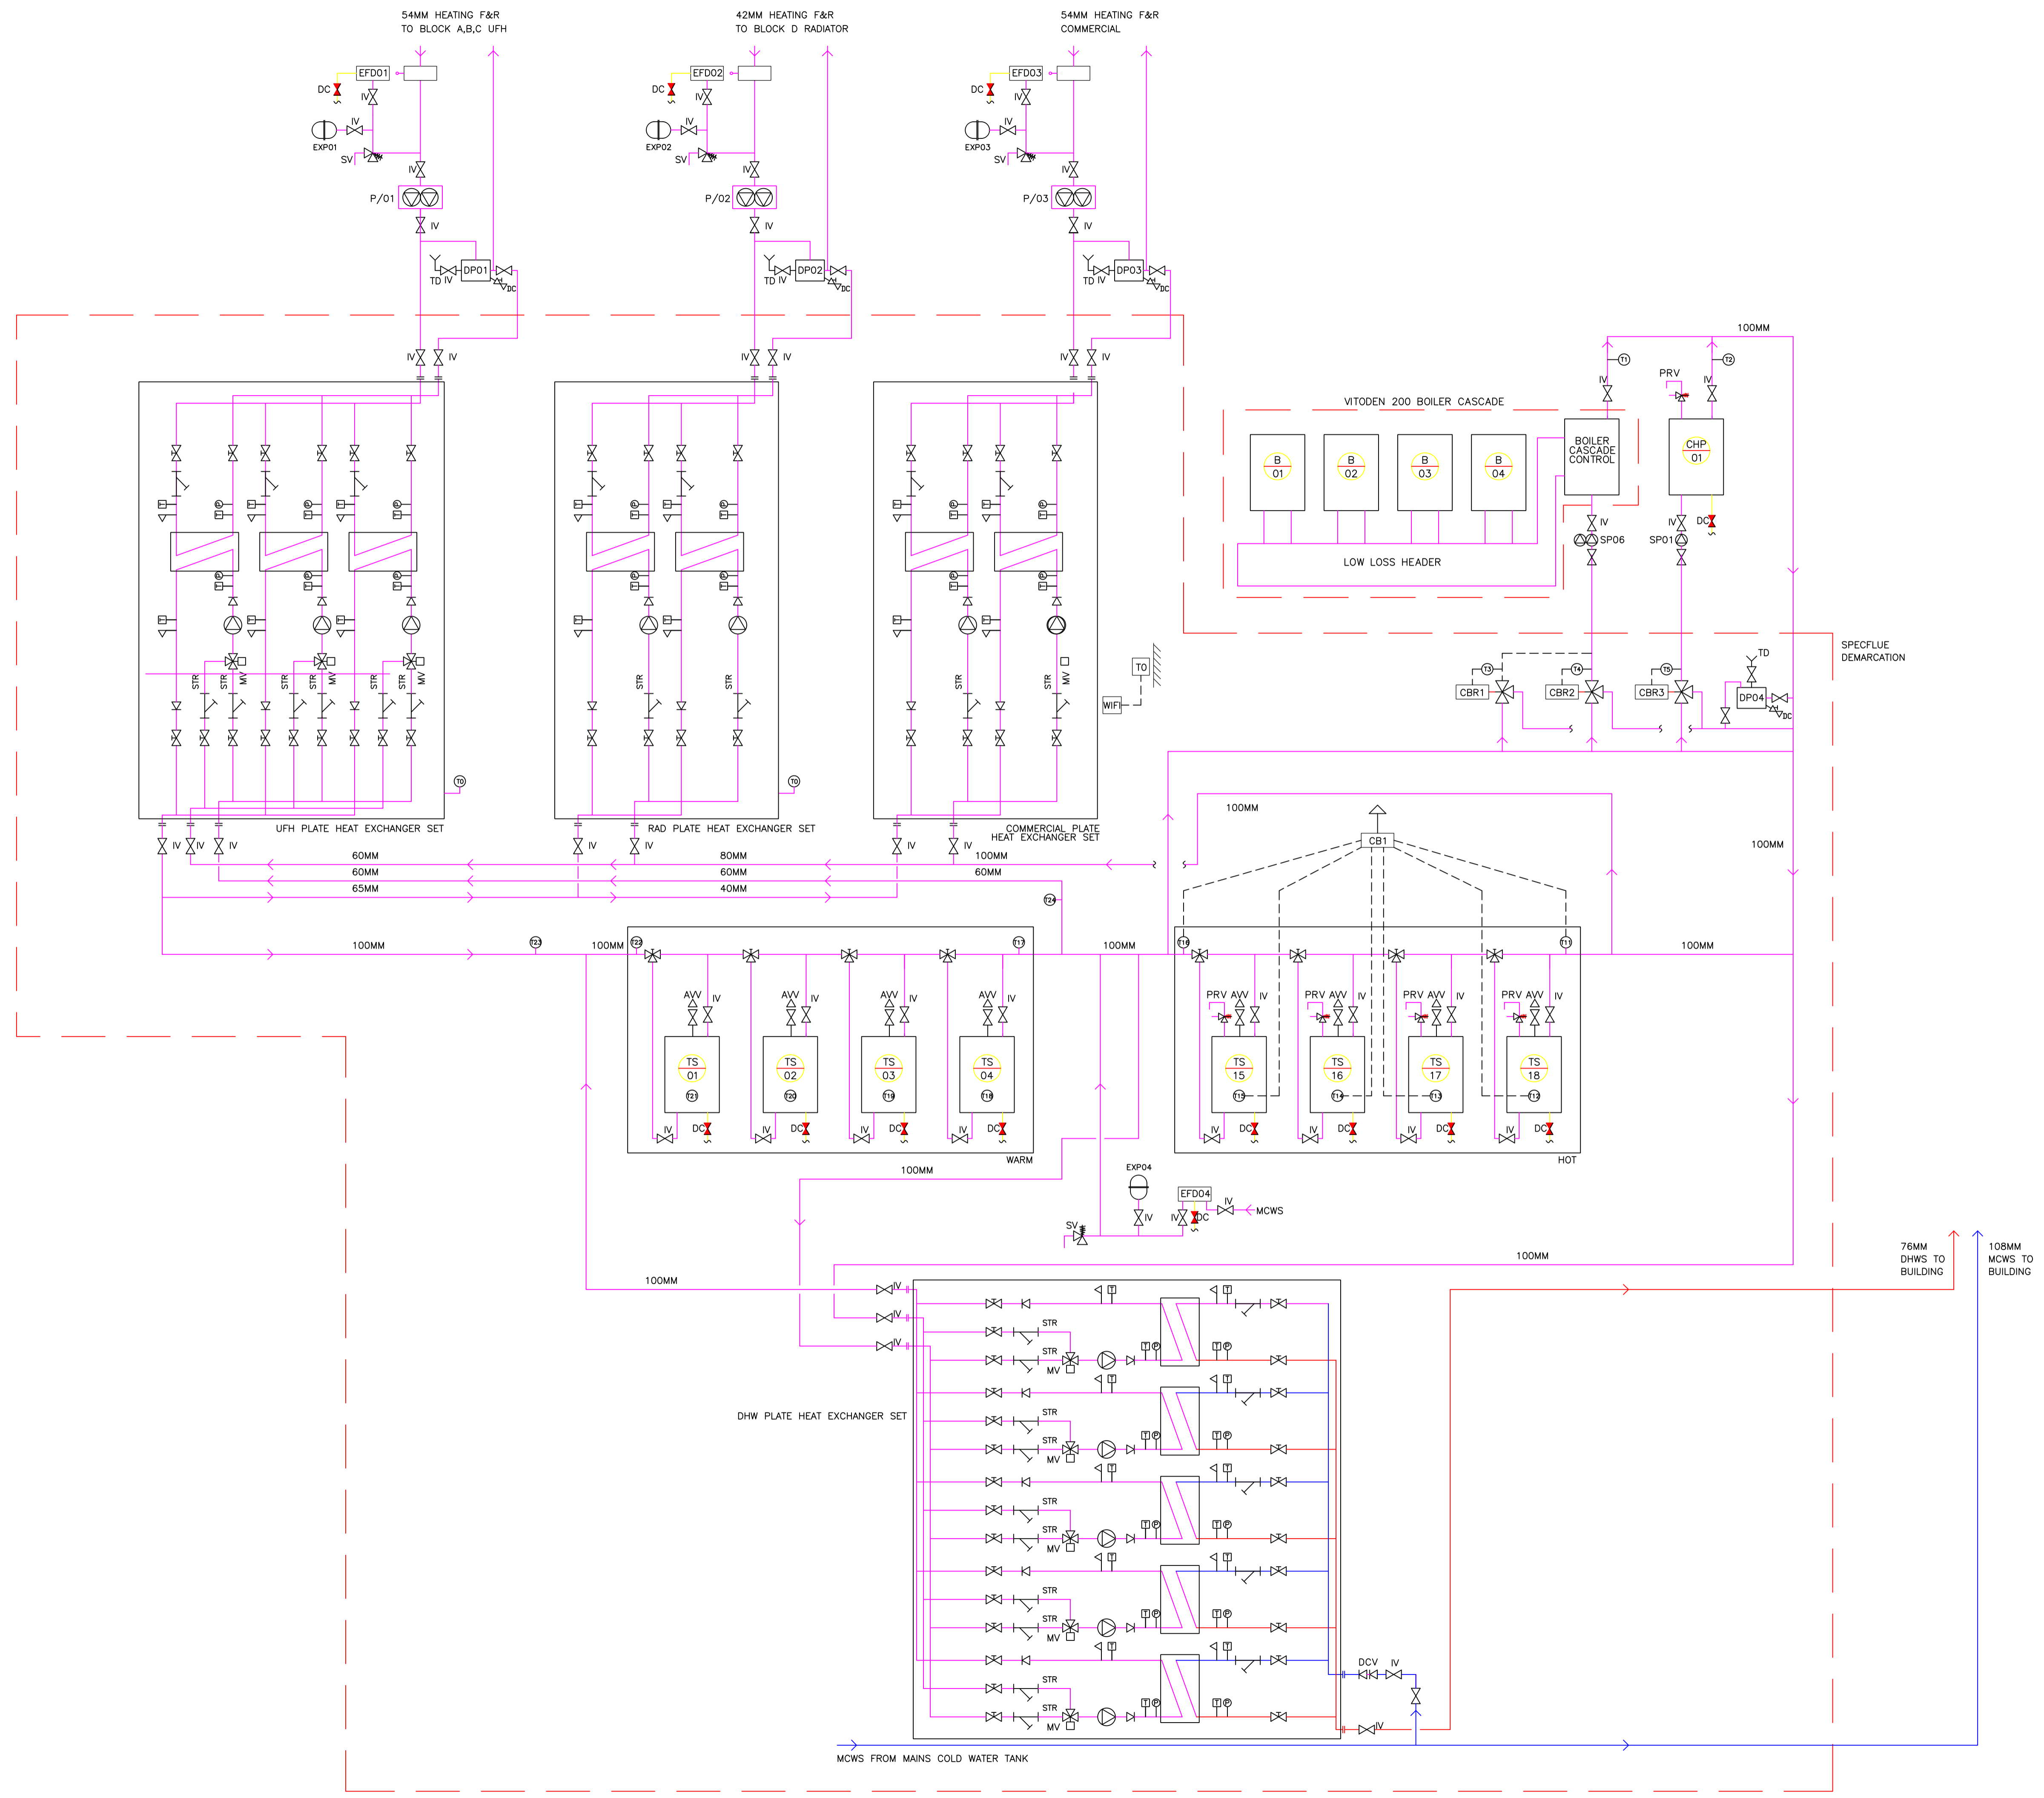

C3	REVISED BOILER ARRANGEMENT	NO	10.09.14
C2	CMT APPROVED FOR CONSTRUCTION	NO	01.09.14
C1	CONSTRUCTION ISSUE	NO	29.08.14
C	DRAFT CONSTRUCTION ISSUE	WO'R	13.03.14

Rev.	Amendment	Initial	Date
------	-----------	---------	------

**Synergy**  
 CONSULTING ENGINEERS  
 Sustainable Mechanical, Electrical and Public Health Building Services  
 8-14 St Pancras Way, 1 Canal Side Studios, London NW1 0GG  
 Tel: 020 7529 8950 Fax: 020 7388 9312 Email: mail@synergyconsult.co.uk Web: www.synergyconsult.co.uk

Client: **Orchid Putney Limited**

Project: **Putney Plaza**

Drawing Title: **Plantroom Schematic HVAC Basement Level +00**

Scale(s)	NTS
Drawn Date	25/07/12
Initial	WOR
Approved	JG

Dwg. **02590/MS/001** Rev. **C3**